



Feasibility and Prospects of the High Resolution Rapid Refresh Model For Dynamic Line Rating

May 2021

Changing the World's Energy Future

Jacob P Lehmer



DISCLAIMER

This information was prepared as an account of work sponsored by an agency of the U.S. Government. Neither the U.S. Government nor any agency thereof, nor any of their employees, makes any warranty, expressed or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or usefulness, of any information, apparatus, product, or process disclosed, or represents that its use would not infringe privately owned rights. References herein to any specific commercial product, process, or service by trade name, trade mark, manufacturer, or otherwise, does not necessarily constitute or imply its endorsement, recommendation, or favoring by the U.S. Government or any agency thereof. The views and opinions of authors expressed herein do not necessarily state or reflect those of the U.S. Government or any agency thereof.

Feasibility and Prospects of the High Resolution Rapid Refresh Model For Dynamic Line Rating

Jacob P Lehmer

May 2021

**Idaho National Laboratory
Idaho Falls, Idaho 83415**

<http://www.inl.gov>

**Prepared for the
U.S. Department of Energy
Under DOE Idaho Operations Office
Contract DE592 AC07-05ID14517**

Feasibility and Prospects of the High Resolution Rapid Refresh Model For Dynamic Line Rating

Jacob P. Lehmer¹, Tyler B. Phillips¹, Alexander W. Abboud¹, Brandon E. Starks¹, Jake P. Gentle¹, Maxwell J. Stapel-Kalat¹

¹Idaho National Laboratory, 1955 N., Freemont Ave, Idaho Falls, ID, USA



BACKGROUND

The ampacity of transmission lines is defined as the maximum amount of current the conductor can safely carry. It is necessary for transmission line operators to apply ampacity limits due to the thermal properties of the conductor. Dynamic Line Rating (DLR) is a technology and technique that uses the environmental conditions or a set of the conditions to calculate the ampacity of the conductor. The way the DLR is calculated has depended upon some amount of physical technology to implement the solution.

OBJECTIVE


The High Resolution Rapid Refresh (HRRR) Model is an atmospheric model that may provide enough resolution to perform dynamic line rating without any hardware at all. The objective is to use this model to perform Dynamic Line Rating. This will solve two of the most pervasive problems in Dynamic Line Rating, how to instrument a transmission line hundreds of miles long and then how to predict near future ampacity sufficient for transmission operators to effectively use. This technique will use the Idaho National Laboratory site as the test location for analysis.

METHODS


- Find archived data for region of interest
- Find GIS data for the region of interest
- Find archived data from the High-Resolution Rapid Refresh Model
- Create a computational fluid dynamics model of the terrain that maps weather stations and HRRR points to the mid points of the transmission line
- Utilize an engine that runs IEEE 738 to calculate the ampacity of the points that have been modelled for both measured and predicted data
- Compare the results of the ampacities for archived real data and archived HRRR data

RESULTS


This data shows the ampacity calculated through weather data and through the HRRR36. The plot shows that the data from the HRRR36 is following the pattern of the weather station. This allows for a reasonable expectation that a larger implementation of the system would also follow the real weather data.

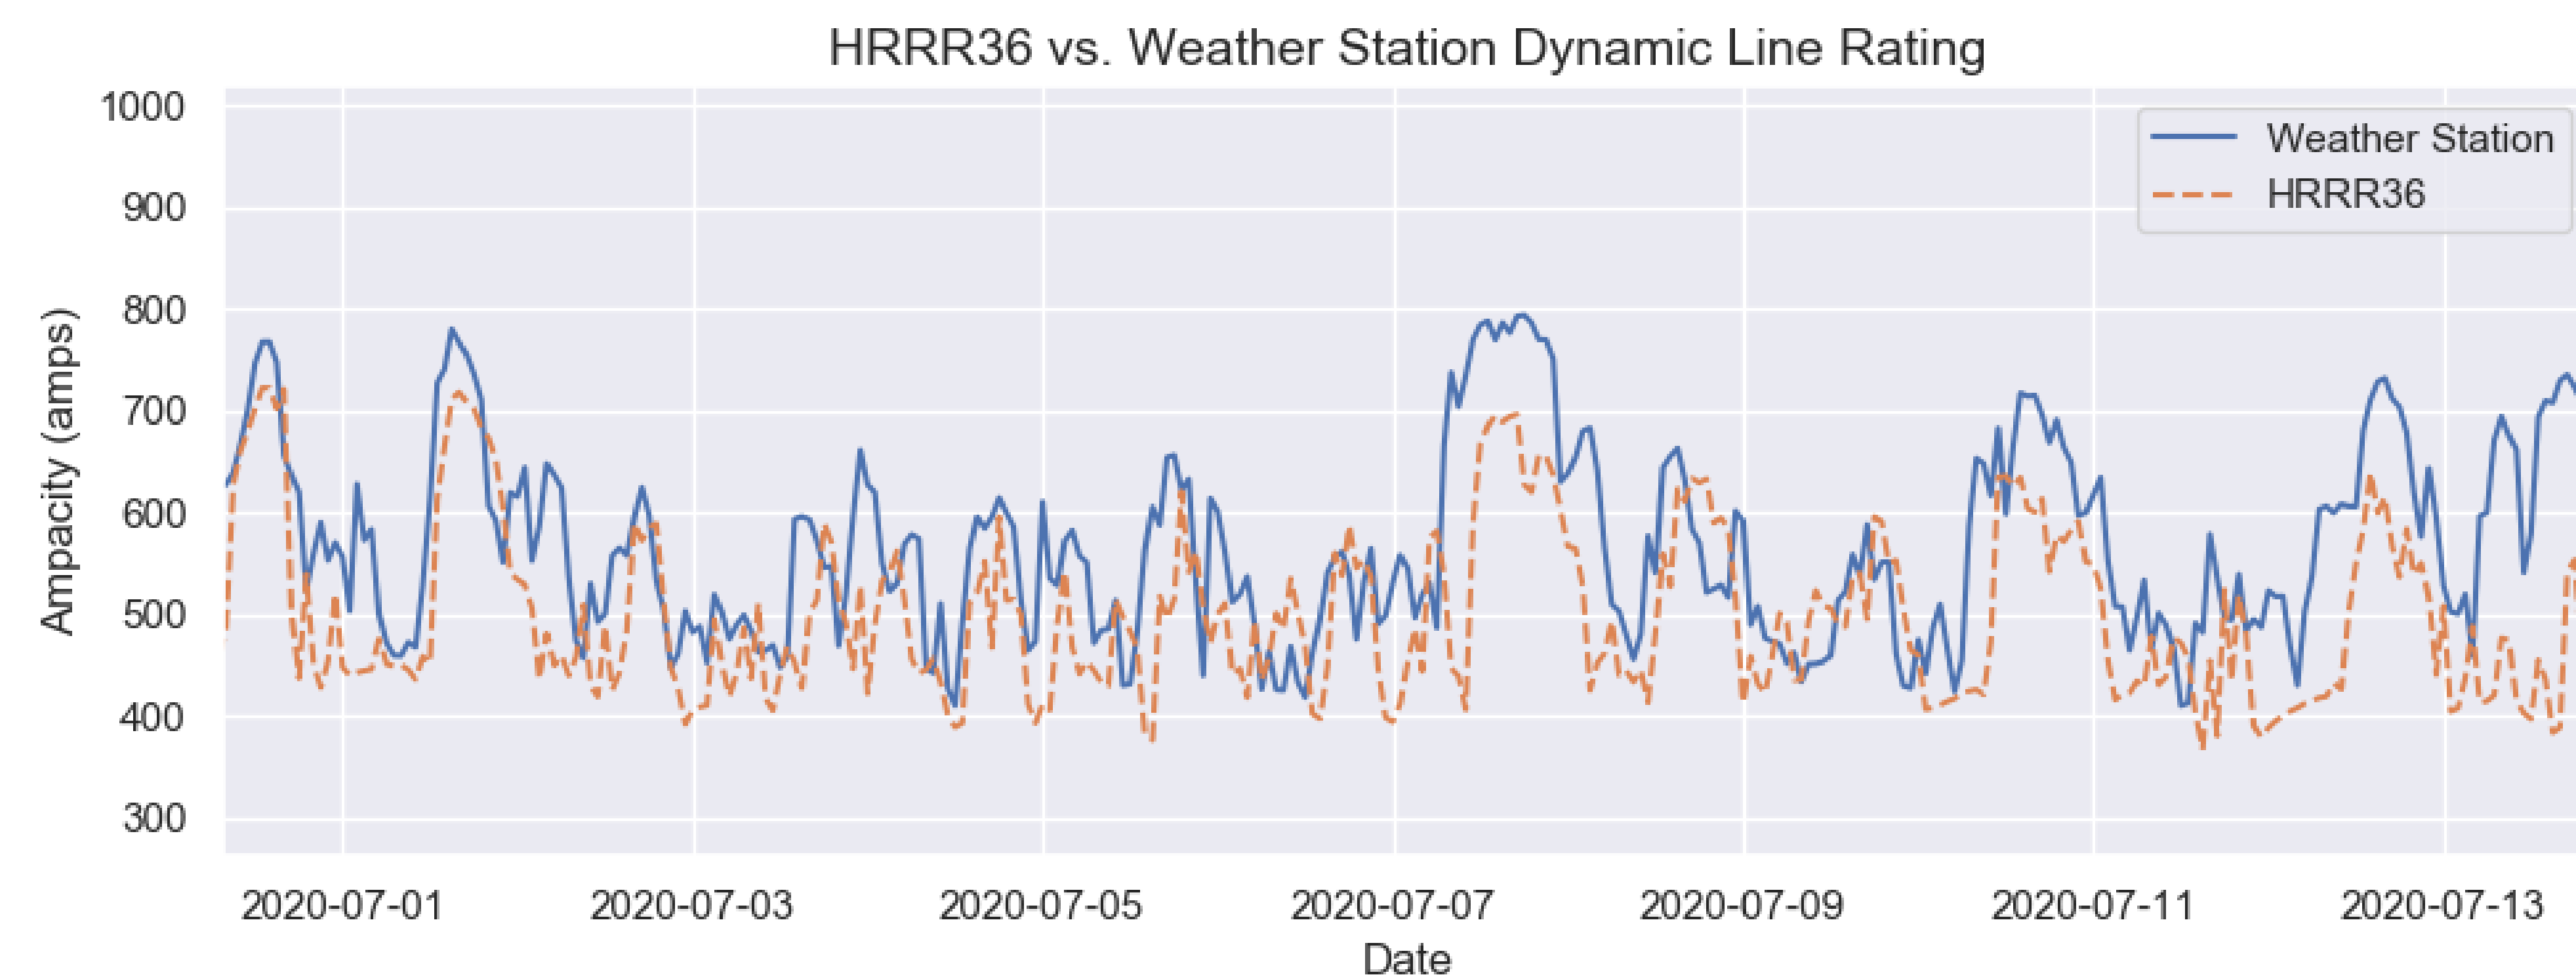

The error between the real measured weather data calculated ampacity and the HRRR36 calculated ampacity shows a bias for the real data to give a higher ampacity than the HRRR36. Higher available ampacity from real measurements implies that the HRRR36 calculated ampacities will not overload the line.

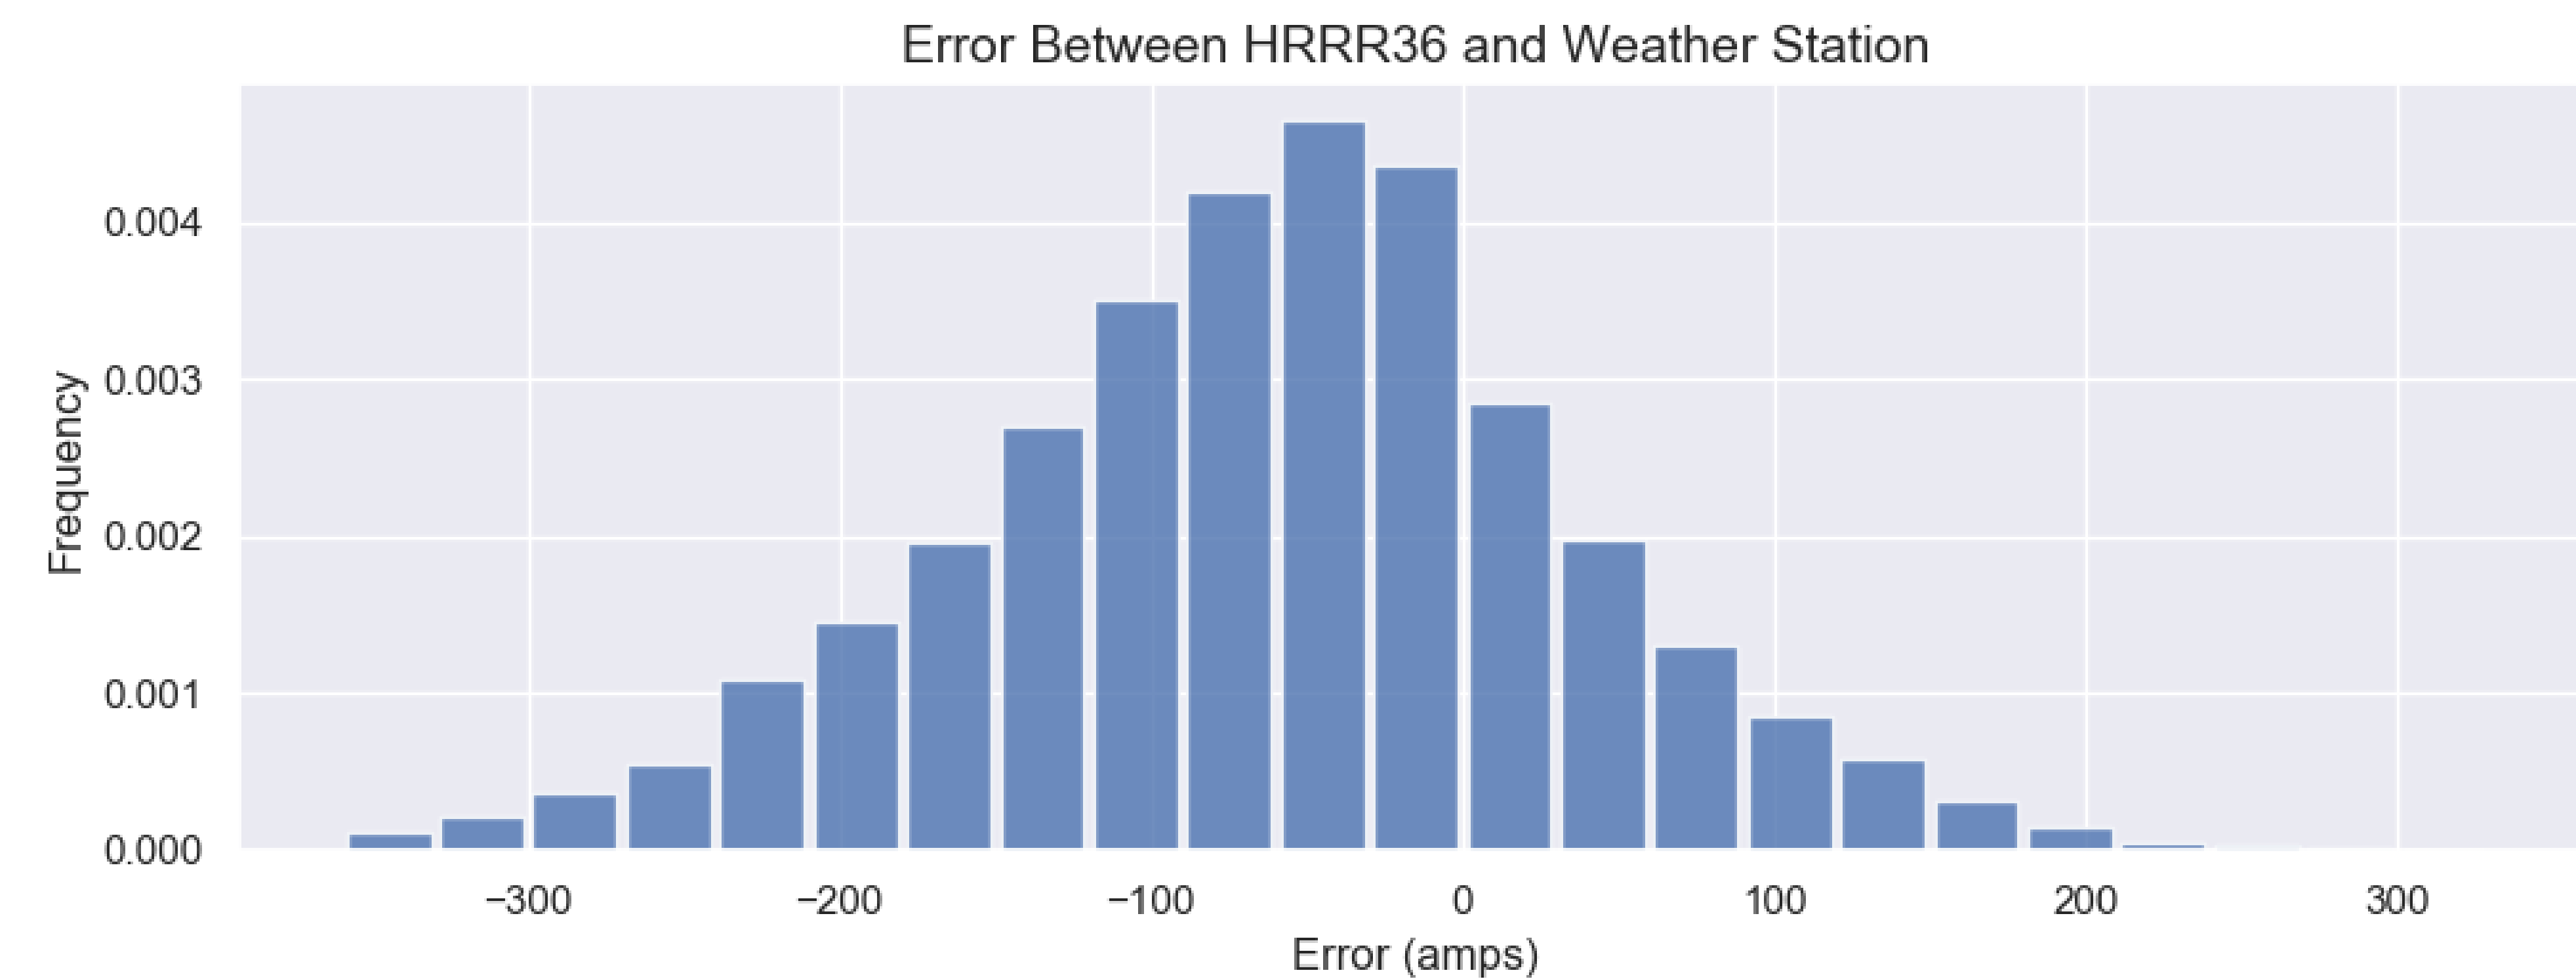

This scatter plot reiterates that the ampacity from the weather stations is higher than the HRRR calculations. There are very few calculations from the HRRR that result in a high ampacity temporary transient. These high ampacity transients are impossible to utilize in a practical manner.

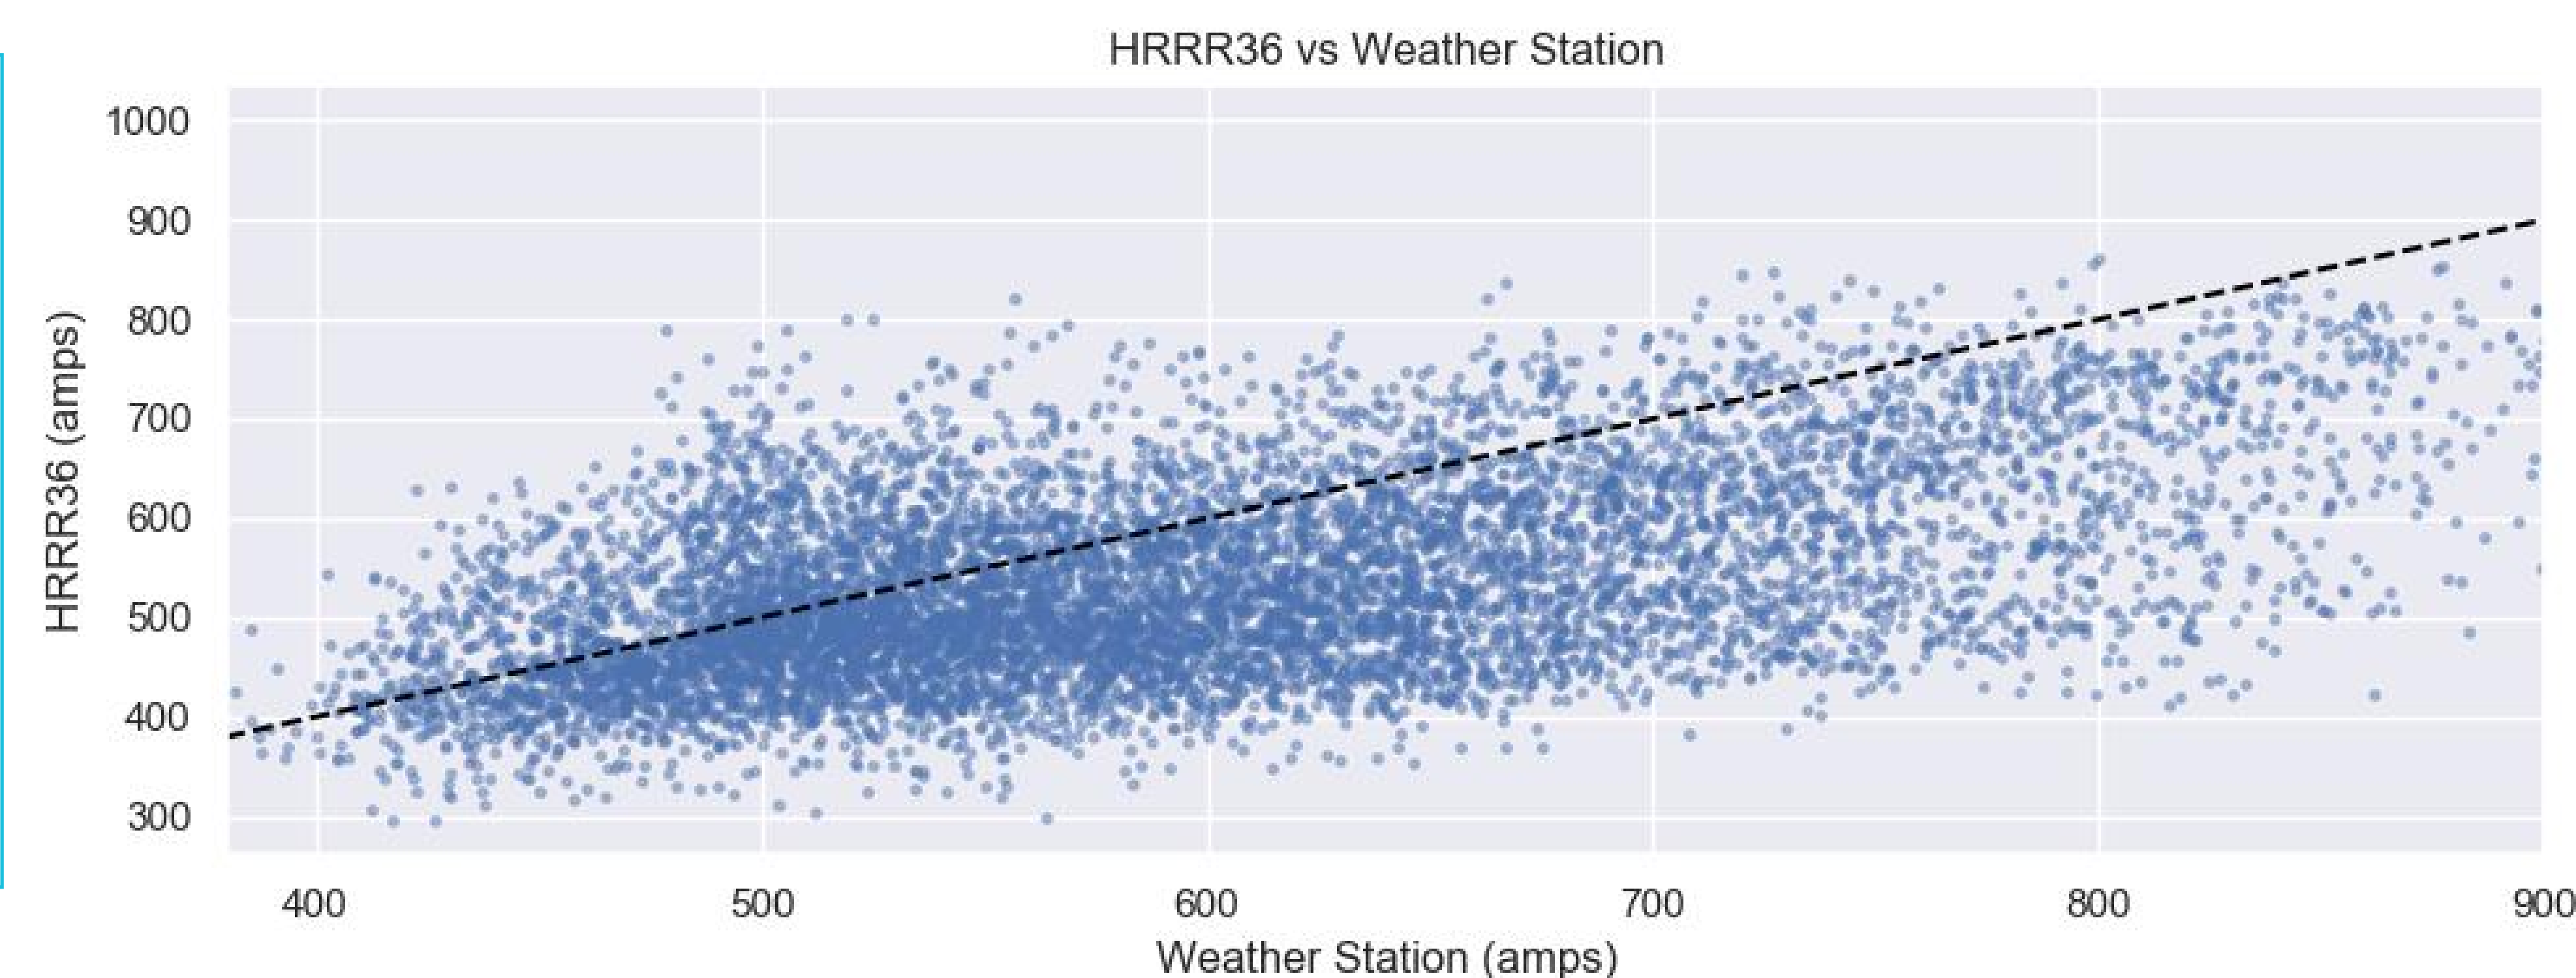

CONCLUSIONS

The High Resolution Rapid Refresh model is a reliable, freely available, and well-maintained weather forecasting model for the entire United States of America. The model provides enough special resolution that additional local weather monitoring devices at location are not necessary to conduct dynamic line rating. The HRRR ratings are lower on average than the locally measured ratings which allows for an additional margin of safety. The adoption of using purely digital methods for dynamic line rating could allow for wide scale adoption of the technology with very little overhead expenditure of implementation.

ACKNOWLEDGEMENTS

Special thank you to Idaho National Laboratory for usage of weather monitoring equipment, and ability to monitor transmission lines.

Special thank you to National Oceanic Atmospheric Administration

This research was conducted by Idaho National Laboratory for the U.S. Department of Energy, Wind Energy Technologies Office. Idaho National Laboratory is operated by Battelle Energy Alliance under contract No. DE592 AC07-05ID14517

REFERENCES

- Abboud A-W et al. Forecasting Dynamic Line Rating with Spatial Variation Considerations. *IEEE Transactions, Unpublished*
- Abboud A-W, et al., "Using computational fluid dynamics of windsimulations coupled with weather data to calculate dynamic line ratings," *IEEE Transactions on Power Deliv-ery*, vol. 35, no. 2, pp. 745–753, 2019.
- Abboud A-W, et al. Coupling computational fluid dynamics with the high resolution rapid refresh model for forecasting dynamic line ratings. *Electric Power Systems Research*, 170, pp.326-337.
- Benjamin S-G, et al., A north american hourly assimilation and model forecast cycle: The rapid refresh, *Mon. Weather Rev.* 144 (2016) 1669–1694.

CONTACT INFORMATION

Jacob Lehmer
Jacob.Lehmer@inl.gov
 208-526-5244

