



ECAR-1524 Results Of Reactor Physics Safety Analysis For Advanced Test Reactor (ATR) Cycle 149B

December 2010

Changing the World's Energy Future

Mitchell A Plummer



INL is a U.S. Department of Energy National Laboratory operated by Battelle Energy Alliance, LLC

DISCLAIMER

This information was prepared as an account of work sponsored by an agency of the U.S. Government. Neither the U.S. Government nor any agency thereof, nor any of their employees, makes any warranty, expressed or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or usefulness, of any information, apparatus, product, or process disclosed, or represents that its use would not infringe privately owned rights. References herein to any specific commercial product, process, or service by trade name, trade mark, manufacturer, or otherwise, does not necessarily constitute or imply its endorsement, recommendation, or favoring by the U.S. Government or any agency thereof. The views and opinions of authors expressed herein do not necessarily state or reflect those of the U.S. Government or any agency thereof.

ECAR-1524 Results Of Reactor Physics Safety Analysis For Advanced Test Reactor (ATR) Cycle 149B

Mitchell A Plummer

December 2010

**Idaho National Laboratory
Idaho Falls, Idaho 83415**

<http://www.inl.gov>

**Prepared for the
U.S. Department of Energy
Under DOE Idaho Operations Office
Contract DE-AC07-05ID14517**

Title: RESULTS OF REACTOR PHYSICS SAFETY ANALYSIS FOR ADVANCED TEST REACTOR (ATR) CYCLE 149B

ECAR No.: 1524

ECAR Rev. No.: 0

Project File No.:

1. Index Codes	Building/Type:	SSC ID:	Site Area:
2. Quality Level and Determination No.:	<i>QL = 1; Determination No. = RTC-000088</i>		
3. Objective/Purpose:	<i>The Upgraded Final Safety Analysis Report (UFSAR) for the Advanced Test Reactor (ATR) requires that a reactor physics analysis be performed for each ATR cycle to assure that each ATR fuel element will operate within safety limits. The results reported in this Engineering Calculations and Analysis Report (ECAR) were obtained using the Upgraded Final Safety Analysis Report (UFSAR) PDQ X-Y model of the ATR core.</i>		
4. Conclusions/Recommendations:	<i>Cycle 149B will run at a total core power of 108 MW for a nominal 56 days. Attached are the reactor physics data in support of the ATR Core Safety Assurance Program for Cycle 149B. The physics analysis contained herein was performed using a total core power of 106 MW with a fuel loading for 56 days. The results of the calculation show that none of the SAR/TSR limits will be violated during cycle 149B when in 2-PCP operation.</i>		

5. Review (R) and Approval (A) and Acceptance (Ac) ¹ :			
		Typed Name/Organization	Signature or eCR No. ²
Performer/Author		P. A. Roth/W321/GB20	<i>B. Curnutt for P. A. Roth 5/26/2011</i>
		B.J. Curnutt/W321/GB25	<i>B.J. Curnutt 5/26/2011</i>
Data Verifier	R	C.C. McKenzie/W321/GB20	<i>C.C. McKenzie 5/26/11</i>
Technical Checker	R	A. W. LaPorta/W321/GB20	Pages checked: All <i>5/26/11</i>
Independent Peer Reviewer ³	R	N/A	
Performer's Manager	A	R.A. Jordan/W321/GB25	<i>R.A. Jordan 5/26/11</i>
Requester	Ac		
Nuclear Safety ³	Ac	N/A	
<i>DOCSAT</i>		<i>michele Robb</i>	<i>michele Robb 5/26/11</i>

1 Review and Approval are required. See LWP-10200 for definitions and responsibilities.

2 Electronic Change Request (eCR) numbers in lieu of signatures on this page indicate electronic final review, approval and acceptance by the listed individuals.

3 If required, per LWP-10200.

4 Required if the ECAR contains safety software validation.

Title: RESULTS OF REACTOR PHYSICS SAFETY ANALYSIS FOR ADVANCED TEST REACTOR (ATR) CYCLE 149B

ECAR No.: 1524

ECAR Rev. No.: 0

Project File No.:

Date: 05/26/11

CONTENTS

SCOPE AND BRIEF DESCRIPTION	2
DESIGN OR TECHNICAL PARAMETER INPUT AND SOURCES	2
RESULTS OF LITERATURE SEARCHES AND OTHER BACKGROUND DATA	2
ASSUMPTIONS	2
COMPUTER CODE VALIDATION	2
DISCUSSION/ANALYSIS	3
RECOMMENDATIONS	3
PE STAMP	3
REFERENCES	3
APPENDIXES	3

APPENDIXES

Appendix A – Results of Reactor Physics Safety Analysis for Advanced Test Reactor (ATR) Cycle 149B

SCOPE AND BRIEF DESCRIPTION

See above

DESIGN OR TECHNICAL PARAMETER INPUT AND SOURCES

1. Natural Phenomena Hazard (NPH) category and source (Performance Category per DOE-STD-1021 and/or Seismic Design Category per ANSI/ANS 2.26) N/A
2. Load scenarios and Acceptance Criteria N/A

RESULTS OF LITERATURE SEARCHES AND OTHER BACKGROUND DATA

The analysis contained herein is performed routinely for each ATR cycle. The plan for performing and documenting the analysis is contained in the Technical Support Guide for the TSR Physics Model.

ASSUMPTIONS

See Appendix A

COMPUTER CODE VALIDATION

- a. Computer type: UNIX Workstation (Castalia) See References 12 and 13 of Appendix A
- b. Computer program name and revision: See Appendix A
- c. Inputs (may refer to an appendix): See Appendix A
- d. Outputs (may refer to an appendix): See Appendix A
- e. Evidence of, or reference to, computer program validation: See Appendix A
- f. Bases supporting application of the computer program to the specific physical problem: See Appendix A

Title: RESULTS OF REACTOR PHYSICS SAFETY ANALYSIS FOR ADVANCED TEST REACTOR (ATR) CYCLE 149B

ECAR No.: 1524

ECAR Rev. No.: 0

Project File No.:

Date: 05/26/11

DISCUSSION/ANALYSIS

See Appendix A

RECOMMENDATIONS

See Appendix A

PE STAMP

N/A

REFERENCES

See Appendix A

APPENDIXES

Title: RESULTS OF REACTOR PHYSICS SAFETY ANALYSIS FOR ADVANCED TEST REACTOR (ATR) CYCLE 149B

ECAR No.: 1524

ECAR Rev. No.: 0

Project File No.:

Date: 05/26/11

Appendix A - Results of Reactor Physics Safety Analysis for Advanced Test Reactor (ATR) Cycle 149B

1. Introduction

The Upgraded Final Safety Analysis Report (UFSAR) for the Advanced Test Reactor (ATR) requires that a reactor physics analysis be performed to evaluate each ATR cycle. The results reported in this Engineering Calculations and Analysis Report (ECAR) were obtained using the Upgraded Final Safety Analysis Report (UFSAR) PDQ X-Y model of the ATR core. Reference 1 identifies a UFSAR commitment to use the UFSAR PDQ X-Y model for the required physics analysis. Nuclide densities for any recycled elements used in the fuel loading of this cycle were obtained from the UFSAR RECYCLE model.

2. Assumptions

Many of the fuel safety limits are expressed in terms of effective plate power (EPP). The EPP for a fuel element plate is the product of the effective point power and the average axial peaking factor. The effective point power is defined as the product of the total core power in megawatts (MW) and the maximum point-to-core-average power density ratio. The average axial peaking factor is obtained by normalizing the axial power profile such that the maximum axial peaking factor is equal to 1.0. The normalized power profile is integrated over the 48-inch active core height and the result is divided by the active core height (48 inches). The result is defined as the average axial peaking factor. The EPP values also include normalization using the ratio of the maximum lobe power to the actual calculated lobe power.

The PDQ analysis of Cycle 149B was run for 56 days (Ref. 5) using a nominal lobe power (MW) division of 18-18-24-23-23 (NW-NE-CR-SW-SE) for a total reactor power of 106 MW. Effective plate power (EPP) values have been computed using maximum lobe powers (MW) of 21-19.5-30-26-26 (NW-NE-CR-SW-SE) for normalization (Ref. 6). Loop experiments (Ref. 5) included in the PDQ model used for this calculation are shown in Table A1, along with lobe nominal, minimum, and maximum powers (Ref. 6).

3. Data

The Cycle 149B fuel charge consists of the following fuel elements:

13 New 7F elements	16 recycle 7F elements
4 New NB elements	4 recycle NB elements
0 New YA elements	0 recycle YA elements
0 New YA...M elements	3 recycle YA...M elements

The loading placement and previous irradiation history is shown in Table A2.

When the reflector adjacent to a lobe receives sufficient radiation exposure that the ligament A stress level exceeds a value of two standard deviations less than the failure stress, the safety limits for the effective point power and EPP for fuel elements adjacent to ligament A of that lobe must be reduced. The most recent update of the reflector lifetime analysis (as required by SAR 4.2.3.6.1) provides values for relating lobe exposure (integrated power) to limiting reflector stress levels. The exposure of the reflector adjacent to the SW and SE lobes has passed the level where the ligament A stress will exceed a value of two standard deviations less than the failure stress. This ECAR documents the reduction in safety limits in those two lobes.

Title: RESULTS OF REACTOR PHYSICS SAFETY ANALYSIS FOR ADVANCED TEST REACTOR (ATR) CYCLE 149B

ECAR No.: 1524

ECAR Rev. No.: 0

Project File No.:

Date: 05/26/11

When the inspection of a new fuel element finds a reduced width in a coolant channel between fuel plates, the effective plate power limit for the plates adjacent to the narrow coolant channel must be reduced. The PDQ model used in this analysis tracks the power in 11 of the 19 fuel element plates. Those plates have numbers 1, 2, 3, 5, 8, 11, 15, 16, 17, 18, and 19. When an element has a reduced width in any coolant channel, the plate power limit will be restricted for any adjacent tracked plate or for the nearest tracked plate if there is no adjacent tracked plate. The fuel elements in the fuel loading for this cycle do not have any restrictions.

4. Analysis and Calculations

The calculation was performed using the PDQWS computer code on the castalia workstation. PDQWS results were processed using a suite of codes, including most importantly, ROSUB, PQMAP, GRAMS, TRNF, GOPPNP, LMFIS, POWCOR, and CRITOS. The cross-sections included in the input deck were generated using the codes: COMBINE, SCAMP, SCRABL, and RZPGM. Fuel inventory data for use in PDQWS is maintained by the codes: RECINV and RECYCLE.

The ATR PDQ model was run to represent the performance of the reactor during normal operation of Cycle 149B. The shim positions corresponding to this operation are shown in Table A5. The lobe powers and values of $K_{\text{effective}}$ for this run are shown in Table A6.

The ATR PDQ model was also run to represent the “worst-case” shim misalignment accident for each lobe. The shim positions corresponding to each misalignment configuration are shown in Table A7 and the resulting lobe powers and values of $K_{\text{effective}}$ are shown in Table A8.

5. Results and Conclusions

The PDQ analysis tracks the EPP in plate 19 and in ten of the remaining 18 plates of each of the 40 elements. The most limiting value in each lobe has been determined by evaluating the EPP in each of the 10 tracked inner fuel plates in each of the 8 elements of each lobe, and then factoring in any restrictions that have been placed on each fuel plate. The value that results from this analysis is often the maximum EPP value in the lobe, but occasionally a restriction causes a plate with less than the maximum EPP to be more limiting. The EPP value can be compared to the effective plate power limit and used in establishing acceptance criteria for the surveillance of the Lobe Power Calculation and Indication System (LPCIS) [TSR 3.6.1 (b)].

Table 1 shows the limits for the EPP as specified in ATR Technical Safety Requirements 3.6.1(a) (Table 3.6.1-1), and modified in Reference 11, for the inner plates along with the most limiting calculated EPP value for the inner plates in each lobe. Inner fuel plates are all plates except plate 19.

Title: RESULTS OF REACTOR PHYSICS SAFETY ANALYSIS FOR ADVANCED TEST REACTOR (ATR) CYCLE 149B

ECAR No.: 1524

ECAR Rev. No.: 0

Project File No.:

Date: 05/26/11

Table 1. Limiting Inner Plate EPP by Lobe

Lobe	Effective Plate Power Limit		Inner Plate Most Limiting EPP By Lobe				
	2 PCP	3 PCP	Pos.	Plate	Restricted to (%) of limit	Days	EPP
NW	362	385	F-33	15	100	0	222
NE	362	385	F-2	5	100	0	212
CR	362	385	F-20	5	100	3	251
SW	362	385	F-22	5	100	0	259
SE	362	385	F-19	5	100	0	257

The most limiting EPP in each lobe is less than the operating limit for 2 primary coolant pumps (PCP), so two-pump operation will be possible for this cycle.

Table 2 shows the most limiting inner plate EPP value in each quadrant rather than in each lobe. Center lobe elements have been combined into the adjacent corner lobe to make the four quadrants.

Table 2. Limiting Inner Plate EPP by Quadrant

Quadrant	Effective Plate Power Limit		Inner Plate Most Limiting EPP By Quadrant				
	2 PCP	3 PCP	Pos.	Plate	Restricted to (%) of limit	Days	EPP
NW	362	385	F-33	15	100	0	222
NE	362	385	F-10	5	100	3	216
SW	362	385	F-22	5	100	0	259
SE	362	385	F-19	5	100	0	257

Table 3 shows the limits for the EPP as specified in ATR Technical Safety Requirements 3.6.1(a) (Table 3.6.1-1), and modified in Reference 11, for plate 19 along with the most limiting calculated EPP value for plate 19 in each lobe.

Table 3. Limiting Plate 19 EPP by Lobe

Lobe	Effective Plate Power Limit		Plate 19 Most Limiting EPP By Lobe				
	2 PCP	3 PCP	Pos.	Plate	Restricted to (%) of limit	Days	EPP
NW	362	387	F-33	19	100	0	207
NE	362	387	F-8	19	100	0	168
CR	362	387	F-20	19	100	45	137
SW	362	387	F-23	19	100	0	221
SE	362	387	F-18	19	100	0	219

The plate 19 most limiting EPP values for each lobe are within the allowable TSR EPP limits for 2-PCP operation. Therefore, 2-PCP operation is still acceptable for this cycle.

Title: RESULTS OF REACTOR PHYSICS SAFETY ANALYSIS FOR ADVANCED TEST REACTOR (ATR) CYCLE 149B

ECAR No.: 1524

ECAR Rev. No.: 0

Project File No.:

Date: 05/26/11

The most limiting EPP values calculated for Cycle 149B elements at each time step are given in Table 4.

Table 4. Limiting EPP at Each Time Step

Plate Type	EPP Limit 2 PCP	Pos.	Plate	Restricted to (%) of limit	Days ^a	Cycle 149B Most Limiting EPP
19	362	23	19	100	0	221
Inner	362	22	5	100	0	259
19	362	23	19	100	3	196
Inner	362	20	5	100	3	251
19	362	23	19	100	10	194
Inner	362	21	5	100	10	247
19	362	23	19	100	17	189
Inner	362	21	5	100	17	241
19	362	23	19	100	24	186
Inner	362	21	5	100	24	233
19	362	23	19	100	31	182
Inner	362	21	5	100	31	231
19	362	23	19	100	38	178
Inner	362	21	5	100	38	225
19	362	23,18	19	100	45	174
Inner	362	19	5	100	45	222
19	362	23	19	100	52	171
Inner	362	22	5	100	52	222
19	362	23	19	100	56	164
Inner	362	21	5	100	56	216

^a Data for the 0-day ganged outer shim case is not included.

Exposure exceeded the value for the limiting A-ligament stress level in the SW and SE lobe during cycle 147A. Core positions F-24 through F-27 in the SW lobe and F-14 through F-17 in the SE lobe are adjacent to ligament A. Therefore the EPP limits in Tables 1-4 above are not applicable to these positions and reduced values as specified in ATR Technical Safety Requirements 3.6.1(a) (Table 3.6.1-1), and modified in Reference 11 must be used. The most limiting EPP values for these positions are given below along with the $<2\sigma$ limits.

Title: RESULTS OF REACTOR PHYSICS SAFETY ANALYSIS FOR ADVANCED TEST REACTOR (ATR) CYCLE 149B

ECAR No.: 1524

ECAR Rev. No.: 0

Project File No.:

Date: 05/26/11

Table 5. Limiting EPP for core positions for which Ligament A stress is $<2\sigma$ to cracking: F-14 through F-17 and F-24 through F-27

Lobe/Plate	Effective Plate Power Limit		Cycle 149B Most Limiting EPP for Ligament A ($<2\sigma$) Positions By Lobe				
	2 PCP	3 PCP	EPP	Pos.	Plate	Days	Restricted to (%) of limit
SW/Inner Plates	353	374	179	24	15	24,56	100
SW/Plate 19	311	310	163	24	19	3	100
SE/Inner Plates	353	374	179	17	15	56	100
SE/Plate 19	311	310	166	17	19	3	100

The elements in several positions of the fuel loading for this cycle, reach a fission density greater than 1.5×10^{21} during the cycle. For these elements, keeping the effective point powers less than the appropriate limits will prevent blistering of the fuel by ensuring that the maximum temperature will be at least 2σ less than 500°F (533°K) as required under UFSAR 4.2.1 as defined in Reference 4. Table 6 shows in which positions the elements have exceeded the 1.5×10^{21} limit at each time step.

Table 6. Fuel Element Positions for which the fission density is greater than 1.5×10^{21}

Days	Position Numbers
0	
3	
10	1,10,31
17	1,10,20,31,40
24	1,10,11,20,21,30,31,40
31	1,10,11,20,21,29,30,31,32,40
38	1,10,11,15,16,20,21,29,30,31,32,37,40
45	1,9,10,11,14,15,16,20,21,25,26,29,30,31,32,34,37,39,40
52	1,9,10,11,14,15,16,20,21,25,26,29,30,31,32,34,36,37,39,40
56	1,9,10,11,14,15,16,20,21,25,26,29,30,31,32,34,36,37,39,40

Once an element exceeds 1.5×10^{21} fission density, its effective point power must not exceed the appropriate limit for its position as defined in Reference 4. Tables 7 and 8 identify the calculated effective point power for the most limiting element in each lobe for an inner plate and plate 19. Lobes with "NA" entries do not have any elements that exceed 1.5×10^{21} fission density during the cycle.

Table 7. Inner Plate Limiting Effective Point Power by lobe for fission density greater than 1.5×10^{21}

Lobe	Effective Point Power Limit		Cycle 149B Most Limiting Effective Point Power By Lobe				
	2 PCP	3 PCP	Pos.	Plate	Restricted to (%) of limit	Days	EPtP
NW	446	465	F-32	5	100	38	231
NE	446	465	F-9	5	100	45	217
CR	446	465	F-20	5	100	17	303
SW	435	453	F-29	5	100	31	213
SE	435	453	F-14	15	100	45	181

Title: RESULTS OF REACTOR PHYSICS SAFETY ANALYSIS FOR ADVANCED TEST REACTOR (ATR) CYCLE 149B

ECAR No.: 1524

ECAR Rev. No.: 0

Project File No.:

Date: 05/26/11

Table 8. Plate 19 Limiting Effective Point Power by lobe for fission density greater than 1.5×10^{21}

Lobe	Effective Point Power Limit		Cycle 149B Most Limiting Effective Point Power By Lobe				
	2 PCP	3 PCP	Pos.	Plate	Restricted to (%) of limit	Days	EPtP
NW	411	428	F-32	19	100	38	162
NE	411	428	N/A	19	100	N/A	N/A
CR	411	428	F-20	19	100	45	159
SW	411	428	F-29	19	100	31	167
SE	411	428	F-16	19	100	38	143

The worst-case LOBE powers equivalent to the TSR 3.6.1a, Table 3.6.1-1 effective plate power limits are shown in Table 9 on the next page. The worst-cases were found by simulating a lobe power unbalance accident using maximum shim unbalances in the PDQ model and the results are subsequently scaled to the limiting effective plate power.

Title: RESULTS OF REACTOR PHYSICS SAFETY ANALYSIS FOR ADVANCED TEST REACTOR (ATR) CYCLE 149B

ECAR No.: 1524

ECAR Rev. No.: 0

Project File No.:

Date: 05/26/11

Table 9. Worst-case Lobe Powers at Effective Plate Power Limit

Lobe	Cycle Maximum LOBE Power (MW)	Maximum Unbalanced LOBE Power (MW)	Type of Position, Type of Plate	Limiting EPP at Maximum Unbalanced LOBE Power (MW)	Position	Plate	Restriction	Transient Effective Plate Power Limits and Overpower Ratios (MW)	Reference Lobe Power for Quadrant ΔT Setpoints (MW)
NW	21.0	33.24	All, inner plates	269	F-38	17	1.00	659/1.45 = 454	56.1*
			All, plate 19	262	F-38	19	1.00	659/1.45 = 454	57.5
NE	19.5	30.03	All, inner plates	245	F-4	17	1.00	659/1.45 = 454	55.6
			All, plate 19	247	F-4	19	1.00	659/1.45 = 454	55.1*
C	30.0	30.45	All, inner plates	220	F-21	5	1.00	659/1.45 = 454	62.8*
			All, plate 19	132	F-30	19	1.00	659/1.45 = 454	104.6
SW	26.0	44.21	All, inner plates	337	F-24	15	1.00	659/1.45 = 454	59.5
			All, plate 19	313	F-24	19	1.00	659/1.45 = 454	64.1
			< 2 sigma, inner plates	337	F-24	15	1.00	641/1.45 = 442	57.9
			< 2 sigma, plate 19	313	F-24	19	1.00	490/1.37 = 357	50.4*
SE	26.0	43.60	All, inner plates	332	F-17	15	1.00	659/1.45 = 454	59.6
			All, plate 19	309	F-17	19	1.00	659/1.45 = 454	64.0
			< 2 sigma, inner plates	332	F-17	15	1.00	641/1.45 = 442	58.0
			< 2 sigma, plate 19	309	F-17	19	1.00	490/1.37 = 357	50.3*

* indicates minimum value for the lobe

Title: RESULTS OF REACTOR PHYSICS SAFETY ANALYSIS FOR ADVANCED TEST REACTOR (ATR) CYCLE 149B

ECAR No.: 1524

ECAR Rev. No.: 0

Project File No.:

Date: 05/26/11

The resulting worst-case lobe powers are used for establishing compliance with Technical Safety Requirement 3.1.1(a) (Table 3.1.1-1 SR#03) for the quadrant differential temperature set point. The effective plate power limits utilized the methods given in Reference 3. Each line in the table selects the element in a specific category that has the most limiting EPP once the individual plate restrictions have been considered. Values in the rightmost column are calculated by multiplying the values in columns 3, 8, and 9 and then dividing by the value in column 5. If the values in the rightmost column were smaller than the values in column 2, it would be necessary to reduce the requested maximum lobe powers accordingly. For this cycle no such adjustment will be necessary.

Table A9 lists the fuel element powers for each time step of the cycle. In order to find the maximum expected fuel element power for the cycle, the element powers in Table A9 are scaled to the lobe maximum power by multiplying by the ratio of the lobe maximum power divided by the actual lobe power. After examining all of the scaled fuel element powers for time steps beyond xenon equilibrium, we find that the maximum expected fuel element power during Cycle 149B is 4.214 MW in core position F-20.

The maximum calculated point-to-average power density ratio at a distance 90% from the edge of the fuel in plate 19 for any element is 2.65 in position F-23 for the time step 0.

The preliminary startup power division normalized to a total core power of 250 MW is: 40.6-36.9-59.8-57.3-55.4(NW-NE-C-SW-SE).

The reactivity estimates and the fission density limits as given in UFSAR Section 4.2.1.2.3 are shown in Table 10.

Table 10. Reactivity Estimates and Fission Density Limits

Lobe	Reactivity Estimate ^a		Fission Density Limit (2.3×10^{21} fissions/cc)	
	MWd	Time in Cycle ^b (Days)	MWd	Time in Cycle ^c (Days)
NW	1103	61.2	1454	69.2
NE	1098	61.0	1652	84.7
C	---	---	1496	49.8
SW	1705	74.1	1962	75.4
SE	1675	72.8	2336	89.8

- The reactivity estimates were obtained using the XSPRJ method.
- The Time in Cycle is based on the nominal power division of 18-18-24-23-23 (NW-NE-CR-SW-SE).
- The Time in Cycle is based on the maximum power division of 21-19.5-30-26-26 (NW-NE-CR-SW-SE).

The results above show sufficient reactivity to sustain the requested lobe power for the cycle length of 56 days. The results also show that the fission density limits should not be exceeded for a cycle length of 56 days in every lobe except the center (CR) lobe. The time in the cycle required to reach the CR lobe fission density limit was calculated using a maximum lobe power of 30 MW. To achieve the fission density limit during a 56 day cycle, a CR lobe average power of approximately 27 MW would have to be sustained. Calculations and operational experience indicate that the CR lobe average power over the entire cycle will probably be approximately 26 MW. Thus, exceeding the fission density limit is considered improbable. Nuclear Engineering will track actual CR Lobe MWds to ensure fission density limits in the CR Lobe are not exceeded during the cycle. The reactivity and fission density data are shown in Figures A1 and A2.

All of the elements in the fuel loading for Cycle 149B are expected to have further recycle potential after the nominal operation of Cycle 146B except for the following:

Title: RESULTS OF REACTOR PHYSICS SAFETY ANALYSIS FOR ADVANCED TEST REACTOR (ATR) CYCLE 149B

ECAR No.: 1524

ECAR Rev. No.: 0

Project File No.:

Date: 05/26/11

Pos.	Serial No.
1	XA343T
10	YA547TM
20	XA698T
21	XA729T
31	XA835T

The methods used in this analysis are found in References 7 and 8.

6. Hardware and Software

Calculations were performed on the castalia workstation – cpu-property number 380414. The analysis codes along with their V&V tracking number are shown in Table 11. The V&V is documented in References 12 and 13.

Table 11. Computer Codes and V&V Tracking Numbers

Software Application Name	Version	Checksum Value	Enterprise Architecture Tracking Number
cmpr	1	1381	114931
critos	2	5760	114934
Fispk	-	50065	224935
gopp1	02/99	37552	207598
grams	2	61942	114939
Lmfis	1	22139	114940
mxfis	-	4291	-
Pdq	1	61283	67621
powcor	1	4227	67618
pqmap	1	8421	114945
pqmapin	-	15808	-
pqxspl	1	16060	114947
recinv	1	11392	114949
recycle	1	56856	114950
rosub	2	29380	114952
rpr2	-	55876	-
rzpgm	1	34117	114953
rzread	-	43442	114954
Trnf	1	2014	114957
updatr	1	25709	114958

Title: RESULTS OF REACTOR PHYSICS SAFETY ANALYSIS FOR ADVANCED TEST REACTOR (ATR) CYCLE 149B

ECAR No.: 1524

ECAR Rev. No.: 0

Project File No.:

Date: 05/26/11

7. References

1. R. T. McCracken letter to Distribution, RTMc-03-98, UFSAR/TSR Conversion Plan for the ATR Core Safety Assurance Program, Revision 1, March 5, 1998
2. S.T. Polkinghorne, Analysis of ATR 3-inch and 6-inch LOCA's for 110MW Two-Pump Operation, TRA-ATR-1374, October 1998
3. R. T. McCracken letter to J. D. Abrashoff, RTMc-18-98, Determination Of Corner Lobe Powers For Quadrant Differential Temperature Setting, June 3, 1998
4. Davis, C. B., Compliance With ATR SAR Commitment on fuel Design Temperatures, TEV-556, October 29, 2009
5. D. J. Schoonen letter to A. W. LaPorta, DJS-18-11, Rev.1, Advanced Test Reactor Cycle 149B Preliminary Experiment Requirements Letter, Revision 2, May 26, 2011
6. R. A. Jordan letter to ATR Cycle Reference Document 15, RAJ-01-11, Requested Lobe Powers for Advanced Test Reactor (ATR) Cycle 149B-1 Startup, May 12, 2011
7. A. C. Smith letter to R. T. McCracken, ACS-23-96, Updated References for the Advanced Test Reactor (ATR) Core Safety Assurance Calculations, July 19, 1996
8. A. C. Smith letter to R. T. McCracken, ACS-07-97, Average Axial Peaking Factors Incorporated in ROSUB and POWCOR For Use With The New TSR, February 24, 1997
9. S.T. Polkinghorne, Power Limits for ATR Fuel Plates with Less-Than-Nominal Thickness Coolant Channels, TRA-ATR-1601, July 2000
10. BEA SP, SP-10.6.2.2, ATR Fuel Element Receipt, Performance Assurance, And Release, Rev 8, December 11, 2007
11. S. T. Polkinghorne, Interim Power Limits for ATR Fuel Plates, EDF-7420, October 2006.
12. P. A. Roth, Verification and Validation of ATR Physics Analysis Software on Workstation Castalia, ECAR-516, February, 2009.
13. Roth, P. A., Verification and Validation of ATR Physics Analysis Software, rzpgm and rzread, on Workstation Castalia, ECAR-593, April 29, 2009.

Title: RESULTS OF REACTOR PHYSICS SAFETY ANALYSIS FOR ADVANCED TEST REACTOR (ATR) CYCLE 149B

ECAR No.: 1524

ECAR Rev. No.: 0

Project File No.:

Date: 05/26/11

Table A1. Experimental Designations and Nominal Power Division for ATR Cycle 149B^{5,6}

<u>Lobe</u>	<u>Power</u>	<u>Loop Experiments</u>
NW	+3 18 -3	2E/NW-160 R#2E
N	-	1D/N-105 Var Flux/Temp Corr. R#0
NE	+1.5 18 -2	MICE Facility with 2 MRW B/Us and Structural 8A & 8B
W	-	1C/W-75 Med. Corr. R#0
C	+3 24 -5	AFIP-7 Four Fuel Plate Experiment
E	-	7-Pin Flux Trap Irradiation Facility with AFC 2D and 2E in E1-E2 respectively, dummy in E3, UW-2 in E4, Drex-A in E5, and Aluminum Fillers in E6-E7
SW	+3 23 -3	2D/SW-218 STD BU R#0
S	-	AGC-2
SE	+3 23 -3	2B/SE-191 STD BU R#1

Title: RESULTS OF REACTOR PHYSICS SAFETY ANALYSIS FOR ADVANCED TEST REACTOR (ATR) CYCLE 149B

ECAR No.: 1524

ECAR Rev. No.: 0

Project File No.:

Date: 05/26/11

Table A2. Summary of Fuel Load for Cycle 149B

Core Pos.	Serial No.	Content		Total MWD	Irradiation History							
		²³⁵ U	¹⁰ B		Cycle	Pos.	Cycle	Pos.	Cycle	Pos.	Cycle	Pos.
1	XA343T	800	0.083	1568	134B-1	3	135C-1	33				
2	XA779TNB	1075	0.000									
3	XA931T	1075	0.660									
4	XA782TNB	1075	0.000									
5	XA875T	926	0.222	856	148A-1	3						
6	XA878T	922	0.214	856	148A-1	8						
7	XA831T	1075	0.660									
8	XA861T	1075	0.660									
9	YA553TM	883	0.185	1020	145B-1	7						
10	YA547TM	755	0.058	1884	145A-1	7	146B-1	24				
11	XA735T	839	0.108	1544	143B-1	27						
12	XA925T	1075	0.660									
13	XA924T	1075	0.660									
14	XA876T	956	0.286	856	148A-1	4						
15	XA872T	900	0.179	1094	148A-1	17						
16	XA633TNB	891	0.000	856	148A-1	2						
17	XA929T	1075	0.660									
18	XA940T	1075	0.660									
19	XA930T	1075	0.660									
20	XA698T	839	0.118	1299	142B-1	12						
21	XA729T	846	0.110	1223	143A-1	18						
22	XA816T	1075	0.660									
23	XA927T	1075	0.660									
24	XA945T	1075	0.660									
25	XA630TNB	909	0.000	904	146B-1	38						
26	XA883T	906	0.187	1021	146B-1	13						
27	XA928T	1075	0.660									
28	XA935T	1075	0.660									
29	XA867T	907	0.213	903	146B-1	29						
30	XA733T	832	0.100	1544	143B-1	24						
31	XA835T	808	0.093	1408	145A-1	19						
32	XA905T	873	0.161	904	147A-1	9						
33	XA778TNB	1075	0.000									
34	XA607TNB	875	0.000	907	146A-1	2						
35	XA864T	920	0.213	707	146B-1	2						
36	XA897T	905	0.191	1157	147A-1	34						
37	XA895T	875	0.146	1157	147A-1	33						
38	XA784TNB	1075	0.000									
39	XA593TNB	914	0.000	883	143A-1	3						
40	YA443TM	799	0.084	1454	133B-1	24						

Title: RESULTS OF REACTOR PHYSICS SAFETY ANALYSIS FOR ADVANCED TEST REACTOR (ATR) CYCLE 149B

ECAR No.: 1524

ECAR Rev. No.: 0

Project File No.:

Date: 05/26/11

Table A3. Plate Restrictions for Fuel Loaded in Cycle 149B^{9,10}

<u>Core</u>	<u>Serial</u>	<u>Restriction</u>	<u>Restricted Plates</u> <u>(of those represented</u> <u>in the PDQ model)</u>
<u>Pos.</u>	<u>No.</u>		
1	XA343T		
2	XA779TNB		
3	XA931T		
4	XA782TNB		
5	XA875T		
6	XA878T		
7	XA831T		
8	XA861T		
9	YA553TM		
10	YA547TM		
11	XA735T		
12	XA925T		
13	XA924T		
14	XA876T		
15	XA872T		
16	XA633TNB		
17	XA929T		
18	XA940T		
19	XA930T		
20	XA698T		
21	XA729T		
22	XA816T		
23	XA927T		
24	XA945T		
25	XA630TNB		
26	XA883T		
27	XA928T		
28	XA935T		
29	XA867T		
30	XA733T		
31	XA835T		
32	XA905T		
33	XA778TNB		
34	XA607TNB		
35	XA864T		
36	XA897T		
37	XA895T		
38	XA784TNB		
39	XA593TNB		
40	YA443TM		

Title: RESULTS OF REACTOR PHYSICS SAFETY ANALYSIS FOR ADVANCED TEST REACTOR (ATR) CYCLE 149B

ECAR No.: 1524

ECAR Rev. No.: 0

Project File No.:

Date: 05/26/11

Table A4. Capsule Facility Loading Used in ATR Cycle 149B Analysis⁵

<u>Facility</u>	<u>Description</u>	<u>Reference</u>
E-1	AFC-2D	KEB-11-11
E-2	AFC-2E	KEB-11-11
E-3	Dummy	KEB-11-11
E-4	UW-2	KEB-11-11
E-5	Drex-A	KEB-11-11
E-6	Aluminum Filler	KEB-11-11
E-7	Aluminum Filler	KEB-11-11
SFT	AGC-2	MED-01-11
A-1	HSA Cobalt	BJH-2-92
A-2	HSA Cobalt	BJH-2-92
A-3	Drex-B	DCJ-01-11
A-4	HSA Cobalt	BJH-2-92
A-5	HSA Cobalt	BJH-2-92
A-6	HSA Cobalt	BJH-2-92
A-7	HSA Cobalt	BJH-2-92
A-8	HSA Cobalt	BJH-2-92
A-9	HSA Cobalt	RAK-04-02
A-10	HSA Cobalt	RAK-04-02
A-11	HSA Cobalt	RAK-04-02
A-12	SFROP	
A-13	EPRI -ZG-D	GWW-06-11
A-14	EPRI -ZG-B	GWW-06-11
A-15	EPRI -ZG-C	GWW-06-11
A-16	EPRI -ZG-A	GWW-06-11
B-1	YSFR	
B-2	USU-1	DJL-02-11
B-3	HSA Cobalt	BJH-73-88
B-4	HSA Cobalt	BJH-73-88
B-5	HSA Cobalt	BJH-73-88
B-6	HSA Cobalt	BJH-73-88
B-7	HSIS (UI and Drexel shuttles)	GWW-04-11, GWW-05-11

Title: RESULTS OF REACTOR PHYSICS SAFETY ANALYSIS FOR ADVANCED TEST REACTOR (ATR) CYCLE 149B

ECAR No.: 1524

ECAR Rev. No.: 0

Project File No.:

Date: 05/26/11

Table A4. Continued

<u>Facility</u>	<u>Description</u>	<u>Reference</u>
B-8	YSFR	
B-9	Aluminum Filler	
B-10	Aluminum Filler	
B-11	Aluminum Filler	
B-12	AGR-2	SBG-01-10
H-1	Hafnium Shim	HAW-02-11
H-2	HSA Cobalt	TMS-06-08
H-3	N-16 MONITOR	
H-4	HSA Cobalt	TMS-06-08
H-5	Hafnium Shim	HAW-02-11
H-6	HSA Cobalt	TMS-06-08
H-7	HSA Cobalt	TMS-06-08
H-8	HSA Cobalt	TMS-06-08
H-9	Hafnium Shim	HAW-02-11
H-10	HSA Cobalt	TMS-06-08
H-11	N-16 MONITOR	
H-12	HSA Cobalt	TMS-06-08
H-13	Hafnium Shim	HAW-02-11
H-14	HSA Cobalt	TMS-06-08
H-15	HSA Cobalt	TMS-06-08
H-16	HSA Cobalt	TMS-06-08
I-1 thru I-20	Beryllium Filler	
I-21	Aluminum Filler	
I-22	UCSB-2	TLM-1-11
I-23	Aluminum Filler	
I-24	Aluminum Filler	

Title: RESULTS OF REACTOR PHYSICS SAFETY ANALYSIS FOR ADVANCED TEST REACTOR (ATR) CYCLE 149B

ECAR No.: 1524

ECAR Rev. No.: 0

Project File No.:

Date: 05/26/11

Table A5. Summary of ATR Shim Positions for ATR Cycle 149B

Time At Power (Days)	NW LOBE						NE LOBE						SW LOBE						SE LOBE					
	Outer Neck			Outer Neck			Outer Neck			Outer Neck			Outer Neck			Outer Neck			Outer Neck			Outer Neck		
	Shims	Shims	Inserted	Shims	Shims	Inserted	Shims	Shims	Inserted	Shims	Shims	Inserted	Shims	Shims	Inserted	Shims	Shims	Inserted	Shims	Shims	Inserted	Shims	Shims	Inserted
	(Deg.)			(Deg.)			(Deg.)			(Deg.)			(Deg.)			(Deg.)			(Deg.)			(Deg.)		
0	40.1	1 2 3 4 5 6		40.1	1 2 3 4 5 6		40.1	1 2 3 5 6		40.1	1 2 3 5 6		40.1	1 2 3 5 6		40.1	1 2 3 5 6		40.1	1 2 3 5 6		40.1	1 2 3 5 6	
0	40.1	1 2 3 4 5 6		51.2	1 2 3 4 5 6		34.4	1 2 3 5 6		40.1	1 2 3 5 6		40.1	1 2 3 5 6		40.1	1 2 3 5 6		40.1	1 2 3 5 6		40.1	1 2 3 5 6	
3	85.4	1 2 3 4 5 6		85.4	1 2 3		79.3	1 2 3 5 6		85.4	1 2 3 5 6		85.4	1 2 3 5 6		85.4	1 2 3 5 6		85.4	1 2 3 5 6		85.4	1 2 3 5 6	
10	85.4	1 2 3 4 5 6		85.4	1 2		79.3	1 2 3 5 6		85.4	1 2 3 5 6		85.4	1 2 3 5 6		85.4	1 2 3 5 6		85.4	1 2 3 5 6		85.4	1 2 3 5 6	
17	85.4	1 2 3 4		85.4	1		85.4	1 2 3 5 6		85.4	1 2 3 5 6		85.4	1 2 3 5 6		85.4	1 2 3 5 6		85.4	1 2 3 5 6		85.4	1 2 3 5 6	
24	85.4	1 2 3		85.4			85.4	1 2 3 5 6		85.4	1 2 3 5 6		85.4	1 2 3 5 6		85.4	1 2 3 5 6		85.4	1 2 3 5 6		85.4	1 2 3 5 6	
31	85.4	1 2		89.8			85.4	1 2 3 5		85.4	1 2 3 5		85.4	1 2 3 5		85.4	1 2 3 5		85.4	1 2 3 5		85.4	1 2 3 5	
38	85.4			89.8			85.4	1 2 3		85.4	1 2 3		85.4	1 2 3		85.4	1 2 3		85.4	1 2 3		85.4	1 2 3	
45	89.8			95.2			85.4	1 2		85.4	1 2		85.4	1 2		85.4	1 2		85.4	1 2		85.4	1 2	
52	100.1			100.1			85.4			85.4			85.4			85.4			85.4			85.4		
56	104.2			111.7			95.2			95.2			95.2			95.2			95.2			95.2		

Table A6. Summary of ATR Core Power and Calculated $K_{\text{effective}}$ for ATR Cycle 149B

Time at Power (Days)	Total Core Power (MW)	Lobe Powers (MW)					$K_{\text{effective}}$
		NW	NE	CR	SW	SE	
0	106	17.2	15.6	25.3	24.3	23.5	0.9823
0	106	17.2	16.9	25.3	23.1	23.5	0.9822
3	106	17.8	17.6	21.9	23.9	24.8	0.9946
10	106	17.6	17.9	21.9	23.7	24.9	0.9925
17	106	17.9	17.6	22.0	24.0	24.6	0.9974
24	106	18.0	17.8	22.1	23.7	24.3	0.9961
31	106	17.6	17.8	22.2	23.9	24.5	0.9978
38	106	17.3	17.3	22.9	24.1	24.4	1.0020
45	106	17.3	17.6	23.0	23.9	24.1	1.0004
52	106	17.6	17.4	22.8	23.5	24.6	1.0014
56	106	17.3	17.8	22.2	24.2	24.5	1.0019

Title: RESULTS OF REACTOR PHYSICS SAFETY ANALYSIS FOR ADVANCED TEST REACTOR (ATR) CYCLE 149B

ECAR No.: 1524

ECAR Rev. No.: 0

Project File No.:

Date: 05/26/11

Table A7. Summary of ATR Shim Positions for ATR Cycle 149B Worst Case Calculations

Lobe	NW LOBE		NE LOBE		SW LOBE		SE LOBE	
	(Deg.)	Inserted	(Deg.)	Inserted	(Deg.)	Inserted	(Deg.)	Inserted
NW	153.9	1 1 1 1 1 1	40.1	1 1 1 1 1 1	40.1	1 1 1 0 1 1	0.0	1 1 1 0 1 1
NE	40.1	1 1 1 1 1 1	153.9	1 1 1 1 1 1	0.0	1 1 1 0 1 1	40.1	1 1 1 0 1 1
CR	0.0	0 0 0 0 0 0	0.0	0 0 0 0 0 0	0.0	0 0 0 0 0 0	0.0	0 0 0 0 0 0
SW	40.1	1 1 1 1 1 1	0.0	1 1 1 1 1 1	153.9	1 1 1 0 1 1	40.1	1 1 1 0 1 1
SE	0.0	1 1 1 1 1 1	40.1	1 1 1 1 1 1	40.1	1 1 1 0 1 1	153.9	1 1 1 0 1 1

Table A8. Summary of ATR Core Power and Calculated $K_{\text{effective}}$ for Worst-Case Calculations

Lobe	Total Core Power (MW)	Lobe Powers (MW)					$K_{\text{effective}}$
		NW	NE	CR	SW	SE	
NW	106	33.2423	14.1579	22.9789	20.5228	15.0981	1.001697
NE	106	15.8297	30.0336	23.3094	16.2634	20.5639	0.997259
CR	106	17.0980	15.9753	30.4478	21.5132	20.9657	1.023778
SW	106	13.4929	9.1001	21.5400	44.2089	17.6581	1.023353
SE	106	9.9287	12.5648	21.6396	18.2627	43.6041	1.022000

Title: RESULTS OF REACTOR PHYSICS SAFETY ANALYSIS FOR ADVANCED TEST REACTOR (ATR) CYCLE 149B

ECAR No.: 1524

ECAR Rev. No.: 0

Project File No.:

Date: 05/26/11

Table A9. Summary of Fuel Element Powers for ATR Cycle 149B

Time At Power (Days)	Total Core Power (MW)	Power (MW) For Fuel Element In Core Positions 1-10									
		<u>1</u>	<u>2</u>	<u>3</u>	<u>4</u>	<u>5</u>	<u>6</u>	<u>7</u>	<u>8</u>	<u>9</u>	<u>10</u>
0	106	2.8	2.9	2.3	1.7	1.2	1.1	1.5	2.3	2.6	2.8
0	106	2.9	3.0	2.4	1.9	1.4	1.3	1.7	2.4	2.7	2.9
3	106	2.6	2.9	2.4	2.1	1.7	1.6	1.9	2.4	2.6	2.6
10	106	2.6	3.0	2.4	2.1	1.7	1.7	1.9	2.5	2.7	2.7
17	106	2.7	2.9	2.4	2.0	1.6	1.6	1.9	2.4	2.7	2.7
24	106	2.8	3.0	2.5	2.0	1.7	1.6	1.9	2.5	2.7	2.8
31	106	2.7	2.9	2.4	2.0	1.7	1.7	1.9	2.5	2.7	2.7
38	106	2.7	2.9	2.4	1.9	1.6	1.6	1.9	2.4	2.6	2.7
45	106	2.7	2.9	2.4	2.0	1.7	1.7	1.9	2.4	2.6	2.7
52	106	2.6	2.8	2.4	2.0	1.7	1.7	1.9	2.4	2.5	2.6
56	106	2.5	2.7	2.4	2.1	1.8	1.8	2.0	2.4	2.5	2.5

Time At Power (Days)	Total Core Power (MW)	Power (MW) For Fuel Element In Core Positions 11-20									
		<u>11</u>	<u>12</u>	<u>13</u>	<u>14</u>	<u>15</u>	<u>16</u>	<u>17</u>	<u>18</u>	<u>19</u>	<u>20</u>
0	106	3.3	3.6	3.2	2.5	2.0	2.1	2.7	3.5	3.9	3.6
0	106	3.3	3.6	3.2	2.5	2.0	2.1	2.7	3.5	3.9	3.6
3	106	2.8	3.2	3.2	2.9	2.8	2.8	3.1	3.5	3.4	3.0
10	106	2.9	3.2	3.2	2.9	2.8	2.8	3.1	3.5	3.4	3.0
17	106	2.8	3.2	3.2	2.8	2.7	2.7	3.0	3.4	3.5	3.0
24	106	2.8	3.2	3.2	2.8	2.6	2.6	3.0	3.4	3.5	3.0
31	106	2.8	3.4	3.2	2.8	2.6	2.6	3.0	3.4	3.6	3.0
38	106	3.0	3.4	3.2	2.7	2.5	2.5	2.9	3.4	3.7	3.2
45	106	3.1	3.4	3.1	2.7	2.4	2.5	2.9	3.4	3.7	3.2
52	106	3.0	3.4	3.2	2.8	2.6	2.6	3.0	3.4	3.7	3.2
56	106	2.9	3.3	3.1	2.8	2.6	2.6	3.0	3.4	3.6	3.1

Title: RESULTS OF REACTOR PHYSICS SAFETY ANALYSIS FOR ADVANCED TEST REACTOR (ATR) CYCLE 149B

ECAR No.: 1524

ECAR Rev. No.: 0

Project File No.:

Date: 05/26/11

Table A9. Continued

Time At Power (Days)	Total Core Power (MW)	Power (MW) For Fuel Element In Core Positions 21-30									
		<u>21</u>	<u>22</u>	<u>23</u>	<u>24</u>	<u>25</u>	<u>26</u>	<u>27</u>	<u>28</u>	<u>29</u>	<u>30</u>
0	106	3.6	4.0	3.6	2.8	2.2	2.1	2.7	3.4	3.5	3.3
0	106	3.6	3.9	3.5	2.6	2.0	2.0	2.5	3.2	3.4	3.3
3	106	3.0	3.4	3.4	2.9	2.7	2.6	2.8	3.1	3.0	2.8
10	106	3.0	3.4	3.4	2.9	2.6	2.6	2.8	3.1	3.0	2.7
17	106	3.0	3.3	3.4	3.0	2.7	2.6	2.9	3.1	2.9	2.7
24	106	2.9	3.3	3.4	3.0	2.7	2.6	2.8	3.1	2.9	2.7
31	106	2.9	3.4	3.4	3.0	2.6	2.6	2.8	3.1	3.0	2.7
38	106	3.0	3.6	3.4	2.9	2.6	2.5	2.8	3.1	3.1	2.8
45	106	3.1	3.6	3.4	2.9	2.5	2.5	2.8	3.1	3.1	2.8
52	106	3.2	3.6	3.3	2.9	2.4	2.4	2.7	3.1	3.1	3.0
56	106	3.1	3.6	3.4	3.0	2.6	2.6	2.9	3.1	3.1	2.9

Time At Power (Days)	Total Core Power (MW)	Power (MW) For Fuel Element In Core Positions 31-40									
		<u>31</u>	<u>32</u>	<u>33</u>	<u>34</u>	<u>35</u>	<u>36</u>	<u>37</u>	<u>38</u>	<u>39</u>	<u>40</u>
0	106	3.0	2.9	2.9	1.7	1.3	1.2	1.6	2.7	2.9	2.8
0	106	3.0	2.9	2.8	1.7	1.3	1.3	1.6	2.7	2.9	2.9
3	106	2.6	2.5	2.7	2.0	1.7	1.7	1.9	2.7	2.6	2.5
10	106	2.5	2.5	2.7	1.9	1.7	1.7	1.9	2.6	2.5	2.5
17	106	2.6	2.6	2.7	1.9	1.7	1.7	1.9	2.6	2.7	2.5
24	106	2.6	2.7	2.7	1.9	1.7	1.7	1.9	2.7	2.8	2.6
31	106	2.6	2.7	2.6	1.9	1.6	1.6	1.8	2.6	2.7	2.6
38	106	2.8	2.7	2.6	1.8	1.6	1.6	1.8	2.5	2.7	2.7
45	106	2.8	2.7	2.6	1.8	1.6	1.6	1.8	2.5	2.7	2.7
52	106	2.7	2.6	2.6	1.9	1.7	1.7	1.9	2.5	2.7	2.6
56	106	2.7	2.6	2.5	1.9	1.7	1.7	1.8	2.5	2.6	2.5

Title: RESULTS OF REACTOR PHYSICS SAFETY ANALYSIS FOR ADVANCED TEST REACTOR (ATR) CYCLE 149B

ECAR No.: 1524

ECAR Rev. No.: 0

Project File No.:

Date: 05/26/11

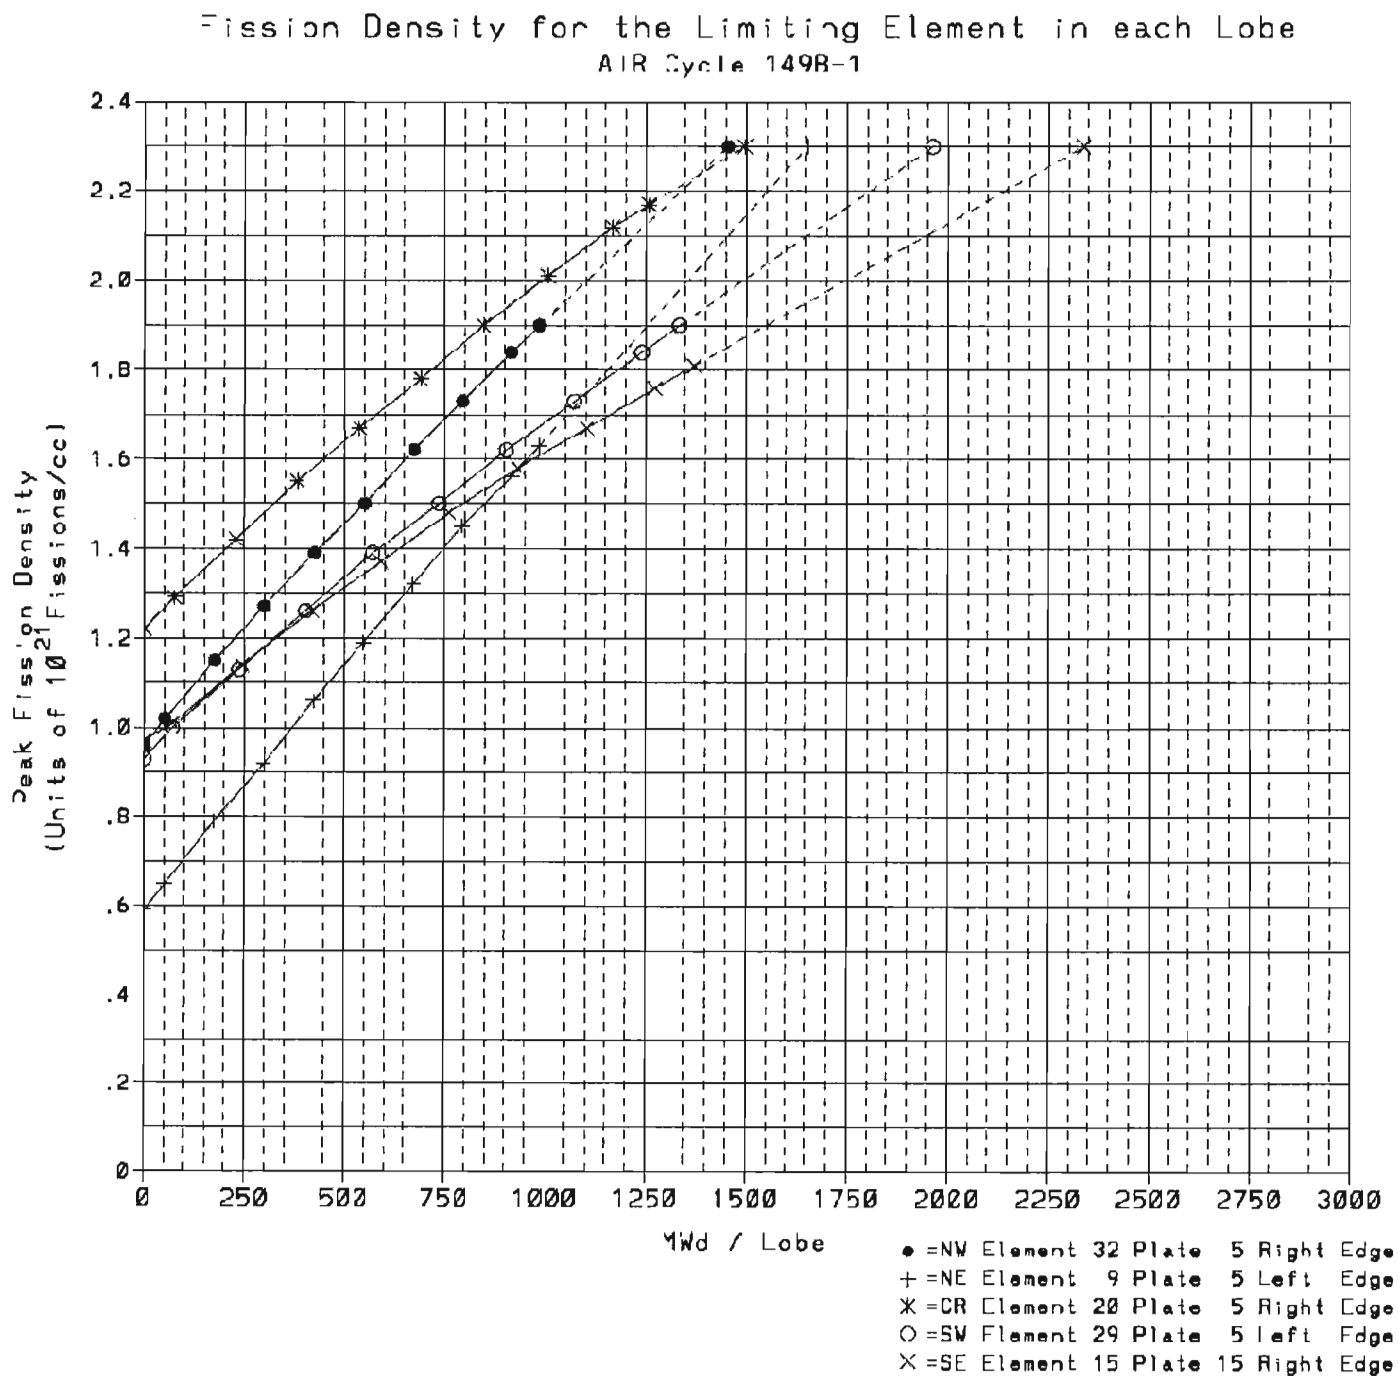


Figure A1. Fission Density for the Limiting Element in each Lobe For Cycle 149B-1

Title: RESULTS OF REACTOR PHYSICS SAFETY ANALYSIS FOR ADVANCED TEST REACTOR (ATR) CYCLE 149B

ECAR No.: 1524

ECAR Rev. No.: 0

Project File No.:

Date: 05/26/11

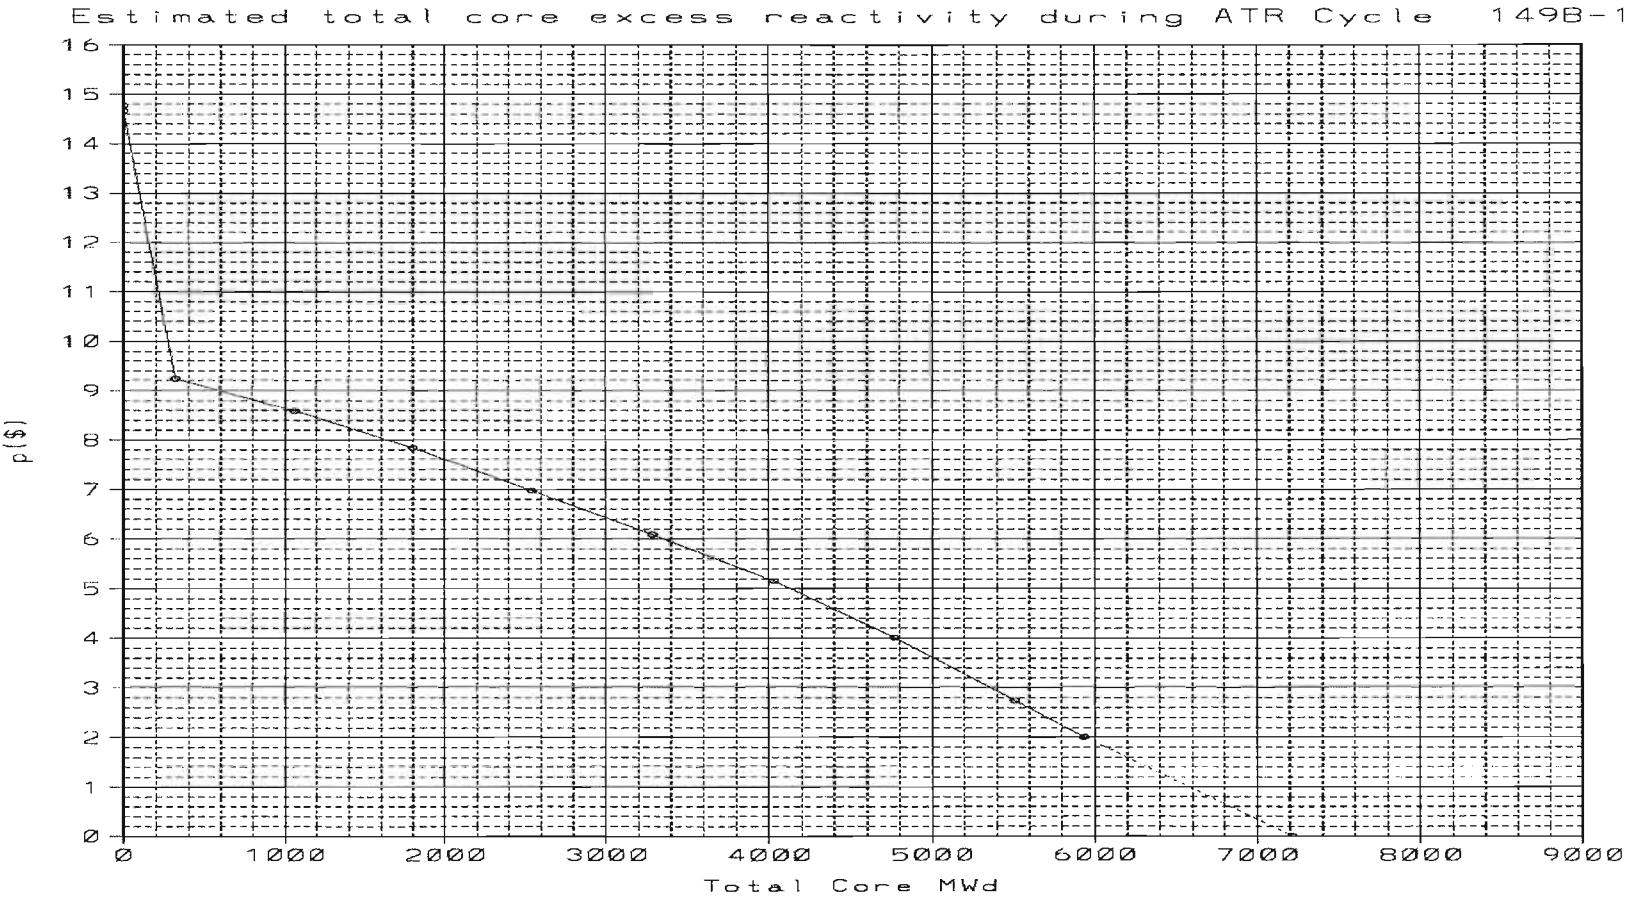


Figure A2. Estimated Total Core Excess Reactivity During ATR Cycle 149B-1